

Adsorption dryer ATK 245

Rev 01_0725

Technical data sheet

Page 1 of 2

Nominal capacity (based on suction conditions 1 bar (a), 20°C)	Unit	Design data
Volume flow inlet	m³/h	2450
Volume flow outlet	m³/h	2107
Average regeneration air	m³/h	343
Compressed air inlet temperature	°C	35
Working pressure	bar g	7
Pressure dew point	°C	-40
Residual oil content	mg/m³	x

General data	Unit	Design data
Maximum operating pressure	bar g	11
Minimum operating pressure	bar g	4
Maximum inlet temperature	°C	50
Ambient temperature minimum	°C	2

Norms and key figures	Unit	Design data
Pressure vessel standard		2014/68/EU
Category		IV
Module	Type	H1
Fluid group		2
Testing pressure	bar g	17.6
Sound insulation level		ISO 85

Scope of supply	Unit	Design data
Ready-to-operate adsorption dryer	Type	ATK 245
Controls	Type	ECOMATIC
Preliminary filter	Type	APFF100-02SMA
Final filter	Type	APFF100-02DMF
Filling	Type	Alumina

Options
Dew point device ET-C
Dew point device ET-P (incl. inlet air control)
Control ECOMATIC24 (24 V DC version)
Pneumatic control PNC

Cycles	Unit	Design data
Total	min	10
Adsorption	min	4.5
Regeneration	min	4.5
Pressure build-up time	min	1

Adsorption dryer ATK 245

Rev 01_0725


Technical data sheet

Page 2 of 2

Dimensions and weights	Unit	Design data
A	mm	2346
B1	mm	2236
B2	mm	287
C	mm	1783
D	mm	898
Nominal size inside the adsorber	Inch	DN 100
Connection input	Inch	DN 100
Output connection	Inch	DN 100
Total weight	Kg	1456
Volume per vessel	Liter	460

Electrical data	Unit	Design data
Installed capacity	W	32
Connector	V	230
Control voltage	V	230
Rate	Hz	50 / 60
Protection class housing	IP	54

Dimensional drawings

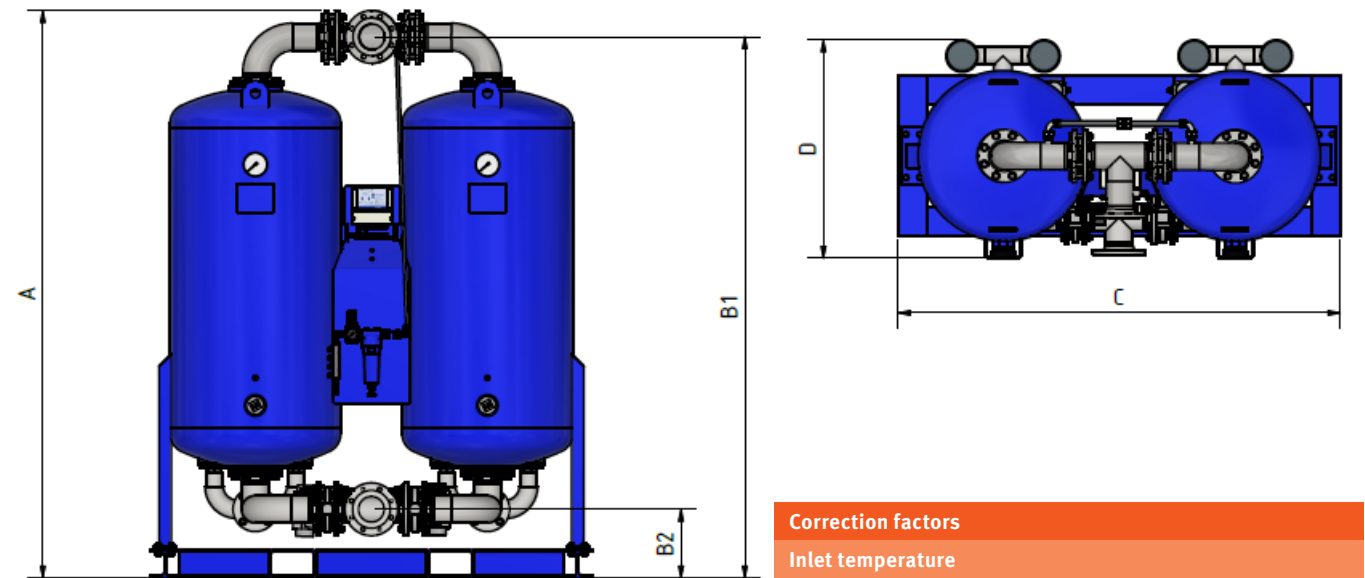



Correction factors																									
Inlet temperature																									
°C	< 25	25	30	35	38	40	45	48	50																
F(t)	1,2	1,1	1,09	1	0,84	0,78	0,72	0,65	0,58																
Correction factors working pressure																									
bar g	4	4,5	5	5,5	6	6,5	7	7,5	8	8,5	9	9,5	10	10,5	11	11,5	12	12,5	13	13,5	14	14,5	15	15,5	16
F(p)	0,6	0,7	0,74	0,82	0,89	0,97	1	1,08	1,11	1,16	1,22	1,29	1,36	1,42	1,5	1,57	1,63	1,69	1,75	1,83	1,9	1,96	2,03	2,1	2,14

Please multiply the capacity with the correction factors in the above table